Hultz/BHU Engineers 1111 Fawcett Avenue, Suite 100 Tacoma, WA 98402 (253) 383-3257

#### WASHINGTON MILITARY DEPARTMENT BUILDING 15 HVAC REPLACEMENT STATE PROJECT NO. 2022-621

### ADDENDUM NO. 3

5-12-23

This Addendum forms a part of the Contract Documents and modifies the original Contract Documents as described. Acknowledge receipt of this Addendum in the space provided on the Form of Proposal. Failure to do so may subject Bidder to disqualification. There are 3 pages to this addendum including all attachments. This Addendum is issued to all known Plan Holders.

#### PRE-BID WALK-THROUGH

1. A pre-bid walk-through was held May 9, 2023; see the attached sign-in sheet for attendees. Issues and questions discussed in the walk-through and during bidding have been answered in this Addendum. Where not answered in this Addendum the issue or question is already answered in the Contract Documents with no further clarification felt to be required.

#### **SPECIFICATIONS**

1. Section 20 05 93, 1.05, B., 2.: **ADD** "h. Velocity Building Technical Services."

#### **DRAWINGS**

- 1. Sheet G1.0, Sheet Index: **ADD** "ME5.1 PHOTO SHEET."
- 2. Sheet ME1.1, General Notes: **ADD** "6. SEE ME5.1 FOR PHOTOGRAPHS OF EXISTING HVAC UNITS."

#### **ATTACHMENTS**

- 1. Pre-bid Sign-in Sheet, 1 page.
- 2. Sheet ME5.1, 1 page.

END OF ADDENDUM

# HULTZ = BHU

# WMD Building 15 Improvements State Project No. 2022-621


## Pre-Bid Walk-Through Sign-In

Hultz Project No. 22-196 May 9, 2023, 9:00am

Name	Representing	Phone	Email	
Jerry Boone	Washington Military Department	253-512-8940	Jerry.Boone@mil.wa.gov	
Tiffany Roberts	Hultz[BHU Engineers	253-383-3257	TiffanyR@HultzBHU.com	
Christopher Williams	Williams Heating and cooling	360-281-7580	Williamsheating and cooling 11c agmail.com	
Min Lee	BFC Construction	253-325-0001	Min Obferonstruction, Com	
Chad Stayton	Elite Mechanical Socias	360.878-2277	childs@elitemechsucs.com	
Dan Gwartney	Cascade Power The	360-402-0249	dance cascade power inc. com	
Guy Hamilton	Crescent Mechanical	833 3054	abby Deveseentinedinc.com	
Brad Metralf	METCALE ELEC	253-330-7113	Brade METCALE 84. COM	
Bill Schmidtle	Cupital Heating	360 239-8045	Bille Contel herding alcooling. com	
John Boyer	Reliable Electric	360-701-1904	john bæreliableelectric. biz	
the Zhoff	WESTERN which I controle	425232850	DEL @ WESTERN MECHANICAL CONTINUES, Con	


1







(E) HVAC-1, 2 & 3

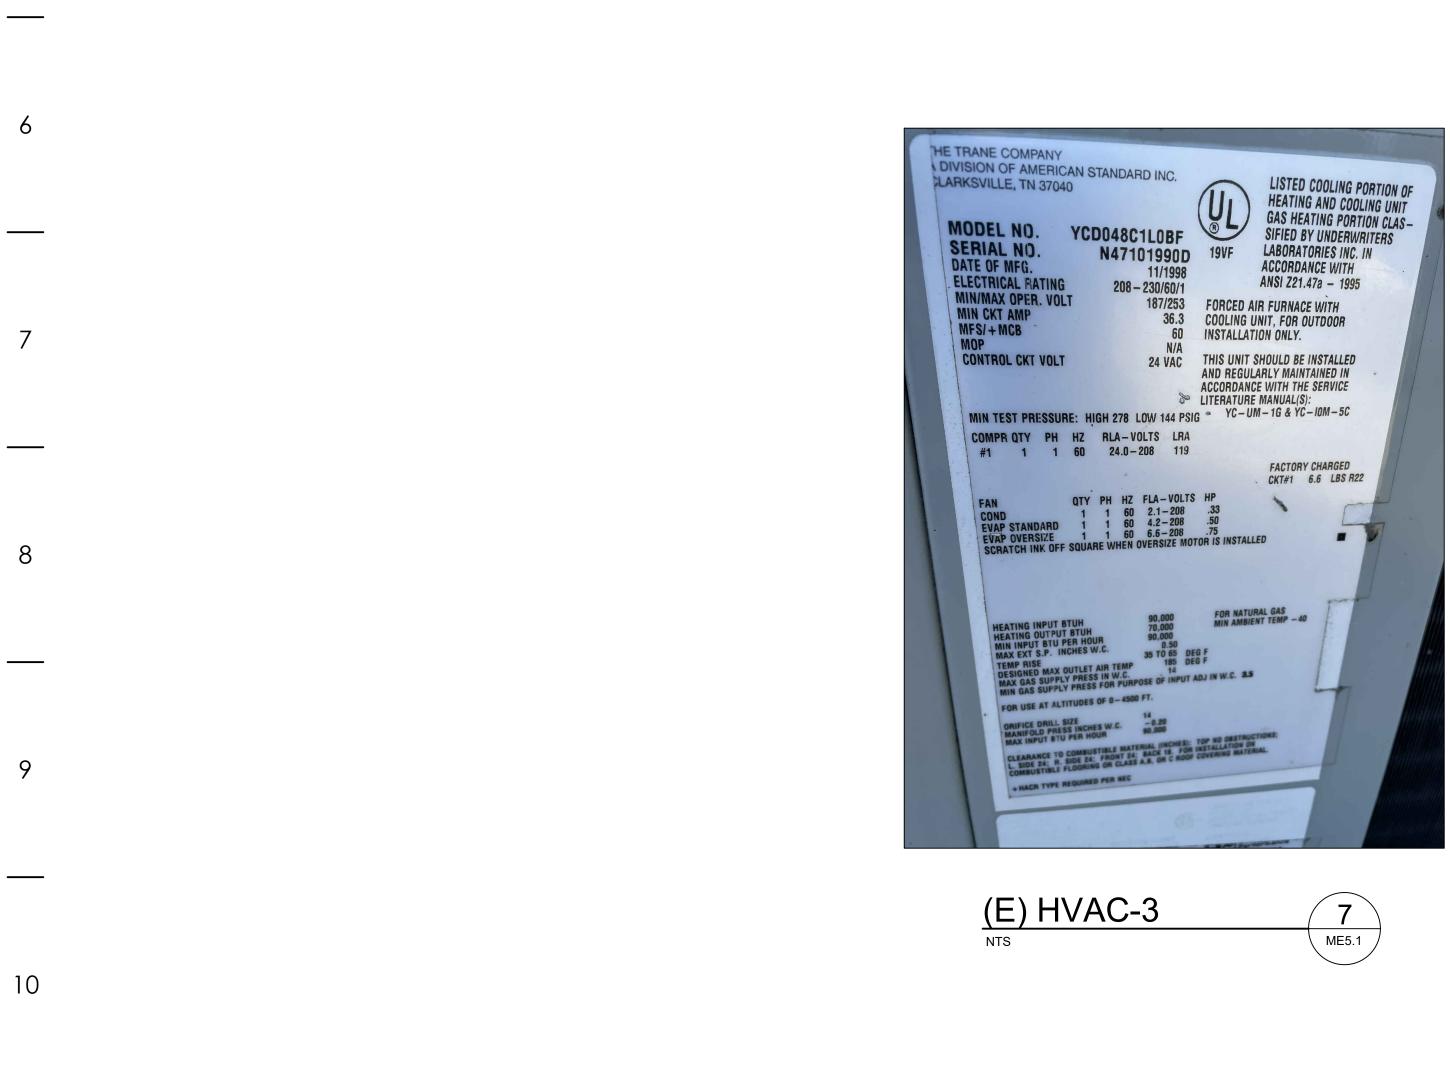

В

А


D


С



Е

3 ME5.1

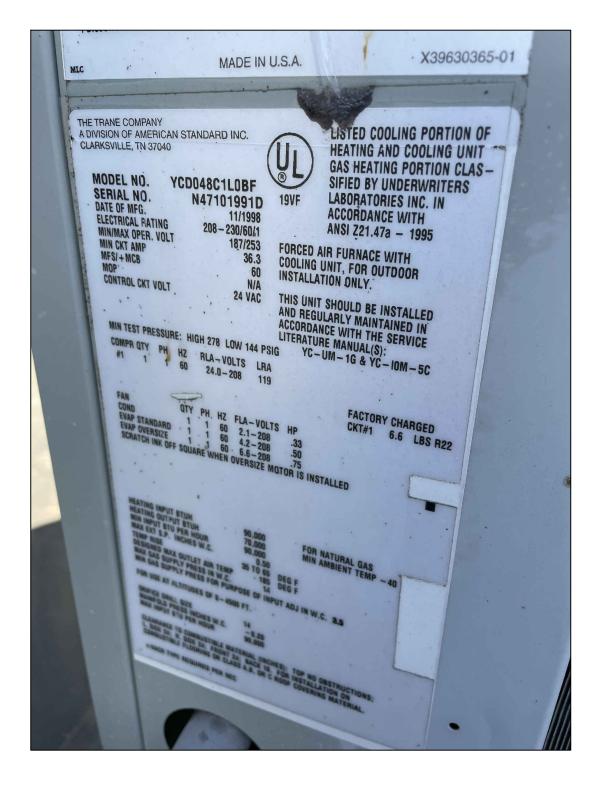



G

F



Η

Н

J J K	1	HULTZ R BHU e n g i n e e r s i n c 1111 Fawcett Ave Suite 100 Phone: (253) 383-3257 Phone: (253) 383-3283 general@hultzbhu.com Job Number: 22-196
	3	JRRAY BLDG 15 EMENTS
(E) HVAC-1, 2 & 3 1   NTS 1	5	WMD CAMP MURRAY HVAC IMPROVEMENT CAMP MURRAY, WA 98430-5050
CLARKSVILLE, TN 37040 MODEL NO. YCD048C1L0BF SERIAL NO. N47101286D DATE OF MFG. 11/1998 ELECTRICAL FATHNG 208-230/60/1 MIN/MAX OPER. VOLT 187/253 MIN CKT AMP 36.3 MFSJ+ MCB 60 MOP N/A CONTROL CKT VOLT 24 VAC MIN TEST PRESSURE: HIGH 278 LOW 144 PSIG YC-UM-1G & YC-IOM-5C COMPR OTY PH HZ FLA-VOLTS LRA #1 1 1 60 24.0-208 119 FAN 0TY PH HZ FLA-VOLTS HP EVAP STANDARD 1 1 60 2.1-208 .33 SCRATCH INK OFF SUIDEF WICH 2.2-208 .50 SCRATCH	6	SIGNED 04-25-2023
HEATING INPUT BTUH HEATING INPUT BTUH HEATING OUPDUT BTUH MIN MPUT BTUH HEATING OUPDUT BTUH MIN MPUT BTUH HEATING OUPDUT BTUH MIN MPUT BTUH MIN MPUT BTUH HEATING OUPDUT BTUH MIN MPUT BTUH MIN AGA SUPPLY PARES IN 0.2 DESIGNED MAX OUTLET AIR TEMP 5T 065 DEG F MIN GAS SUPPLY PRESS IN PURPOSE OF INPUT ADJ IN W.C. 25 DESIGNED MAX OUTLET AIR TEMP 10.0 DESIGNED MAX OUTLET AIR TEMP 10.0 DES	8 	SHEET TITLE: PHOTO SHEET DRAWN: BS CHECKED: TR DATE: 04-29 REVISIONS:
ADDENDUM NO. 3	10	ME5.1
J   K		0" 1" 2 //// V////////////////////////////////